

## POWER QUALITY ANALYZER 3197

Power Measuring Instruments



# The Most Comprehensive Portable PQA on The Market

Catch Power Quality Problems on the Fly...












# Measure Power and Power Quality on Single to Three-Phase Circuits Quickly and Effortlessly

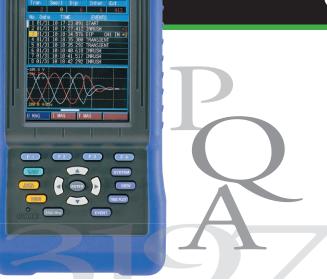

## Feature 1: Vector Multimeter



Use the wiring map, vector map and data monitor to check for proper wiring before taking measurements — don't miss out on important power data just because of minor wiring mistakes!

A quick glance at the correct vector map will show you if your wiring is correct


# Feature 2: **QuickSet**

With QuickSet, all you have to do is just Set, Clamp and Measure!


Line frequency			Auto
Measurement Interval		:	Auto
Nominal Voltage		:	Auto
Event	Swell	:	110%
thresholds	<b>Dip</b>	:	90%
against nominal	Interruption	:	10%
voltage	▶ Transient	:	ON

Let QuickSet help you take care of all the time-consuming setup procedures. All you need to do is select your circuit, clamp sensor and range, and then let QuickSet do the rest of the work for you.

Testing Parameters Automatically Defined by QuickSet Redefine Thresholds Easily with Intuitive Key Panel



## Feature 3: Power & Power Quality



## Measure all the necessary power parameters simultaneously

Check for sudden inrush during motor startup and diagnose breaker trips due to over current all on the same measurement interface. View RMS data for every half cycle over a 30 second period on a large graph display

PROOFFO IN SPAR | 100A | 100V | 60 0 1 Hz | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100 | 100


All items are recorded as events so that a quick understanding can be obtained just by viewing the waveform

# Power & Energy Voltage Current Frequency Power and Power Factor Voltage Tenergy Voltage Tenergy Voltage ThD(voltage) Active/Reactive Energy


Voltage Fluctuation (dips and swells)

### Power Quality

- ✓ Inrush Current
- THUSH CUITCH
- ✓ Voltage Swells
- ✓ Voltage Dips
- Transient
- Overvoltage
- ✓ Interruptions

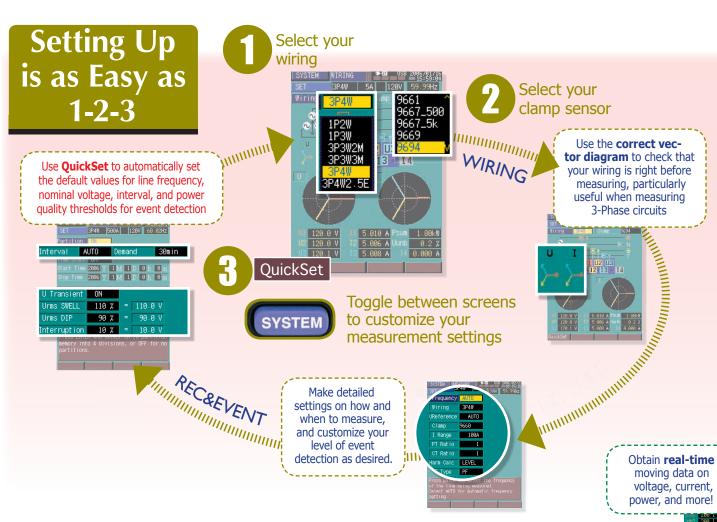



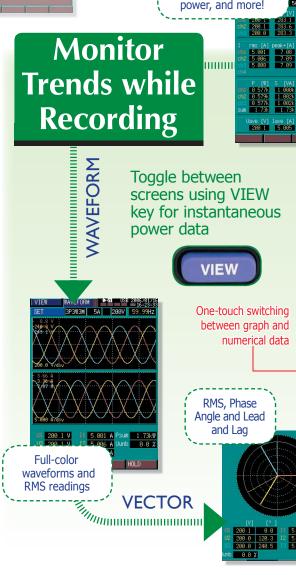

environments and uses

#### Record Auto-Data Find the max, Compression Lets You and Inspect min and average values for any point Record for up to 125 using the cursor (even while measuring) function **Days DIP/SWELL RMS** TIME PLOT Toggle between the trend Get a detailed picture during voltage anomalies graphs for a complete analysis fluctuation range for all 3 of the power situation channels are displayed Consumed & Regenerated Active Power Lag and Lead of **Reactive Power** ENERG. **Demand Graph** DEMAND and maximum and average values displayed in one window Total MAX Total AVE Display events AND their waveforms at the same time **Identify** ...... **Power Quality WAVEFORM** DMM **Problems** Switch between voltage and current graphs, and zoom Harmonic in on the time axis at the waveforms of touch of a button voltage, current **Inrush current** and active power **fluctuations** are captured to the 50th order in RMS at a fast 10ms sampling rate and displayed Toggle between across a 30-second window events for a complete picture of the power anomaly Store up to 50 Events "I" marks an ETAILS 20 058 16 1P2W 58A 188V 68 Inrush Event HARMONICS **RMS** voltage fluctuations such as swells and dips GRAP/LIST are clearly displayed Record L, grap, internal memor, at event detection Scroll down and select to display the finer details of any event 125.0 V **RMS**

### Feature 4: **Bundled PC Application** Software

Two Integrated Programs for **Data Download and Viewing** Standard USB connection lets you download data at a snap, and immediately view your measurements with the DataViewer



Open downloaded recordings with DataViewer to manage and process your captured power data on your PC.



## Mobility, Portability Plus **Convenient Data Transfer Right to Your PC**

## Feature 5: Compact Design Makes for Long Battery Life



**6 Hours of Continuous Use on a Single Recharge** 

Non-volatile Ni-MH rechargeable battery pack keeps important measurement data in memory even after power is turned off.

A PQA that TRULY fits in the palm of your hand.

### **Standard 3197 Package Fulfills All the Requirements** for Checking Voltage Anomalies



To measure current and power, please select one or more of our HIOKI Clamp On Sensors detailed on the back of this catalog.

#### ■ Measurement Specifications (Guaranteeed Accuracy Period: 1 Year)

RMS Voltage and Current True RMS (200 ms calculation ) Voltage Accuracy ±0.3% rdg. ±0.2%f.s Current Accuracy ±0.3% rdg. ±0.2%f.s. + Clamp sensor accuracy Voltage (1/2) RMS True RMS Measurement (one cycle calculation refreshed every half cycle) Accuracy ±0.3% rdg. ±0.2%f.s. Current (1/2) RMS Measurement Frequency

regeneration)

Demand

(half-cycle calculation, half-cycle voltage synchronized) Accuracy ±0.3% rdg. ±0.2%f.s. + Clamp sensor accuracy Effective Measurement range: 45.00 to 66.00 Hz Accuracy ±0.01 Hz ±1 dgt. (when input is at least 10% of range)

**Active Power Accuracy** ±0.3% rdg. ±0.2% f.s. (for consumption and

+ clamp-on sensor accuracy (P.F.=1)

Reactive Power Accuracy ±1 dgt. of calculation from each measurement (for lags and leads) value

Effect of Power Factor ±1.0% rdg. (50 /60Hz, P.F.=0.5)

Apparent Power Accuracy ±1 dgt. of calculation from each measurement value

Power Factor and ±1 dgt. of calculation from each measurement value **Displacement Power** (DPF calculated from phase difference between Factor Accuracy fundamental voltage and current waveforms) (leading phase indicated)

Active or Reactive Energy Selectable between consumption, regeneration, Consumption lag and lead

±1 dgt. applied to active and reactive power measurement accuracy

Selectable between active or reactive power ±1 dgt. applied to active and reactive power Accuracy measurement accuracy

Harmonic Analysis Orders Up to 50th (2048 points/window, rectangular) Harmonic Voltage, 1st to 15th order ±0.5% rdg. ±0.2% f.s. Current and Power 26th to 25th order ±1.0% rdg. ±0.3% f.s.

for harmonic power)

Other Measurement Items

Current and Power Accuracy

Accuracy is not defined

Accuracy is not de 46th to 50th order ±4.0% rdg. ±0.3% f.s. (add accuracy of clamp sensor to harmonic current accuracy) Peak Voltage and Current, K Factor, Voltage Unbalance Factor, Max/Min/Ave of Time Series

#### **■Event Detection** Voltage Swells (Rise), Voltage RMS value detected using voltage (1/2) measured Dips (Drop), Interruptions every half cycle RMS value detected using current (1/2) every half cycle Inrush Current Transient Overvoltage Detection Range: 50 Vrms (±70.7 Vpeak equiv.) or more, 10 to 100 kHz Detect events at preset intervals selectable from **Timer Detection** OFF, 1, 5, 15 or 30 minutes; 1, 2 or 12 hours; or 1 day Manual Detection Detect events when keys are pressed Set to OFF or to specified value, except for Thresholds detection of transient overvoltages. (Waveform recording not available for transients.) **Event Recording Lengths**

Waveform 20ms before detection + 200ms upon detection + 30ms after detection

Event voltage fluctuation graph 0.5s before + 2.5s after detection Inrush current graph 0.5s before + 29.5s after detection

Maximum Number of 50 event waveforms, 20 event voltage fluctuation Recordable Events graphs, 1 inrush current graph, 1000 event counts

#### ■Input Specifications

Wiring Configurations	Single-phase 2-wire (1P2W), single-phase 3-wire (1P3W), three-phase 3-wire (3P3W2M and 3P3W3M), three-phase four-wire (3P4W and 3P4W2.5E)				
Measurement Line frequency	Auto-select (50/60 Hz)				
Maximum Allowable Input Voltage	Voltage input terminal: 780 V AC (1103 Vpeak) Current input terminal: 1.7 V AC (2.4 Vpeak)				
Maximum Rated Voltage to Ground	Voltage input terminal: CATIII 600 V AC, CATIV 300 V AC (50/60 Hz) Current input terminal: per clamp-on sensors used				
Measurement Method	Simultaneous digital sampling of voltage and current (sampling frequency: 10.24 kHz per channel)				
Voltage Measurement Range	600.0V (Crest factor 2 or less)				
Current Measurement Range: Manual ranging according to clamp sensor (Crest factor 3 or less)	Clamp Sensor Range 9657-10, 9675 500.0 mA/5.000 A 9694, 9695-02 5.000 A/50.000 A 9660, 9695-03 10.00 A/100.0 A	Clamp Sensor Range 9661, 9667 (500A) 50.00 A/500.0 A 9669 100.0 A/1.000 kA 9667 (5000A) 500.0 A/5.000 kA			
Power Measurement Range: <i>Depends on</i> combination of current range	<b>500mA</b> 300.0W/600.0W/900.0W <b>5A</b> 3.000kW/6.000kW/9.000kW <b>10A</b> 6.000kW/12.00kW/18.00kW				

50A 30.00kW/60.00kW/90.00kW

5kA 3.000MW/6.000MW/9.000MW

and measurement line

<b>■BASIC SPECIFICATIO</b>	NS
Display	4.7-inch color STN LCD
Display languages	English, Japanese or Chinese (Simplified)
Display refresh rate	Approx. once per second
Clock functions	Auto calendar, auto leap year, 24-hour format
Real-Time Clock accuracy	Within 13 seconds/month
Internal Memory Capacity	4MB
Maximum recording time	125 Days
Interval Settings	AUTO, 1, 5, 15 and 30 min., and 1 hour (AUTO sequentially selects 1, 2, 10, 30 seconds, 1, 5, 15 and 30 min., and 1 hour automatically)
Demand period	15 min., 30 min. and 1 hour
Recordable Items	All parameters (incl. max/min/average values)

<b>ETNTEREA</b>	CF SPECIFI	<b>ICATIONS</b>

Interface	USB 2.0 (Full Speed)
Connection destination	Computer operating on Windows 2000/ XP

<b>■ENVIRONME</b>	NTAL AN	D SAFETY-RELATED SPECIFICATIONS		
Operating environment	Indoors, up to 2000 m (6562-ft.) ASL			
Temperature	Storage	-10 to 50°C (14 to 122°F), 80% RH or less (non-condensating)		
and humidity	Operation	0 to 40°C (32 to 104°F), 80% RH or less (non-condensating)		
Applicable Safety		EN61010, Pollution degree 2, Measurement Categories III (600 V) and IV (300 V) (anticipated transient overvoltage 6000 V)		
standards	EMC	EN61326 Class A EN61000-3-2, EN61000-3-3		
Power source	AC Adapter 9418-15 or Battery Pack 9459 (Maximum rated power: 23 VA (with AC adapter)			
Continuous operating time with battery pack	Approx. 6 hours (after full charge, with 5 min. auto-off LCD backlight)			
Dimensions and mass	128 W × 246 H × 63 D mm (5.04"W × 9.69"H × 2.48"D) (including stand) Approx. 1.2 kg (42.3 oz.) (with battery pack)			

<b>■CLA</b>	■CLAMP ON SENSOR SPECIFICATIONS							
		9694	9660	9661	9669	9667	9695-02	9695-03
М	ODEL	€ CAT III 300V 3m cord	€ CAT III 300V 3m cord	€ CAT III 600V 3m cord	€ CAT III 600V 3m cord	CAT III 1000V  The from sensor to circuit to connector to	C € CAT III 300V	C € CAT III 300V
Measurable o	conductor diameter	φ15	mm	φ46mm	φ55mm, 80×20mm	φ254mm	φ15ι	mm
Primary o	current rating	AC 5A	AC 100A	AC 500A	AC 1000A	AC 500A/5000A	AC 50A	AC 100A
Outpu	ıt voltage	AC 10mV/A	AC 1mV/A	AC 1mV/A	AC 0.5mV/A	AC 500mVf.s.	AC 10mV/A	AC 1mV/A
Accuracy	Amplitude (45 to 66 Hz)	±0.3%rdg.±0.02%f.s.	±0.3%rdg.±0.02%f.s.	±0.3%rdg.±0.01%f.s.	±1.0%rdg.±0.01%f.s.	±2.0%rdg.±1.5mV	±0.3%rdg.±0.02%f.s.	±0.3%rdg.±0.02%f.s.
	Phase (5Hz to 5kHz)	within ±2°	within ±1°	within ±0.5°	within ±1°	within ±1° (minimum 10% input)	within ±2°	within ±1°
	y characteristic cy deviation)	within	±1.0% at 40Hz to 5	5kHz (9669: within ±	-2.0%)	±3dB at 10Hz to 20kHz	within ±1.0% a	t 40Hz to 5kHz
	ted voltage to lated conductor)	300Vrms	300Vrms	600Vrms	600Vrms	1000Vrms	300\	/rms
	m allowable 15 to 66 Hz)	50A continuous	130A continuous	550A continuous	1000A continuous	10000A continuous	60A continuous	130A continuous
Dimensio	ns and weight	46W×135H×21Dmm, 230g	46W×135H×21Dmm, 230g	77W×151H×42Dmm, 360g	100W×188H×42Dmm, 590g	Sensor length 910mm, 140g	51W×58H×1	9Dmm, 50g
Requ	irements					AC Adapter 9445-02/03 (Option)	Connection Cord 9	9219 (3m; Option)

<b>■</b> COMPLETE LIST OF OPTIONS	
CLAMP ON SENSOR (100A)	9660
CLAMP ON SENSOR (500A)	9661
FLEXIBLE CLAMP ON SENSOR (5000A)	9667
CLAMP ON SENSOR (1000A)	9669
CLAMP ON SENSOR (5A)	9694
CLAMP ON SENSOR (50A)	9695-02
CLAMP ON SENSOR (100A)	9695-03
CONNECTION CORD (for the 9695-02/9695-03)	9219
CLAMP ON LEAK SENSOR (10A)	9657-10
CLAMP ON LEAK SENSOR (10A)	9675
VOLTAGE CORD (bundled with the standard 3197)	L9438-55
AC ADAPTER (bundled with the standard 3197)	9418-15
BATTERY PACK (bundled with the standard 3197)	9459
PQA-HiVIEW Pro PC Application Software	9624-50

#### **■3197 STANDARD BUNDLE CONFIGURATION**

Includes all the equipment you need to measure voltage. For current or power measurements, please select from our wide assortment of clamp on sensors.

VOLTAGE CORD L9438-55 (3m cord length), BATTERY PACK 9459, AC ADAPTER 9418-15 , USB Cable, Input Terminal Labels, Input Cord Labels, 3197 Applications PC Program (CD-ROM), strap, carrying case, measurement guide, instruction manual

	9675	9657-10	
MODEL	3m cord C € CAT III 300V	3m cord (€ CAT III 300V	
Measurable conductor diameter	φ30mm	φ40mm	
Primary current rating	AC 10A	AC 10A	
Output voltage	AC 100mV/A	AC 100mV/A	
Amplitude Accuracy (45 to 66 Hz)	±1.0%rdg.±0.005%f.s.	±1.0%rdg.±0.05%f.s.	
Phase Accuracy (50/60Hz)	within ±5°	within ±3°	
Residual Current	1mA (10A on forward and return)	) 5mA (100A on forward and return)	
Frequency characteristic (accuracy deviation)	within ±5% at 40Hz to 5kHz	within ±3% at 40Hz to 5kHz	
Max. rated voltage to earth	300Vrms (insulated conductor)		
Maximum allowable input	10A continuous	30A continuous	
Dimensions and weight	60W×113H×24Dmm, 160g	74W×145H×42Dmm, 380g	
Notes	Not compatible with power measurements		

#### ■SUGGESTED OPTIONS for POWER MEASUREMENTS

3P4W Circuit testing of motors and breakers: 3197 Standard Package + 9661 (500A Sensor)×3 3P4W Circuit testing of external CTs:

3197 Standard Package + 9694 (5A Sensor)×3

3P Leakage testing:

3197 Standard Package + 9675 (10A Sensor)×3

Note: Company names and Product names appearing in this catalog are trademarks or registered trademarks of various companies.



#### HIOKI E.E. CORPORATION

Headquarters:
81 Koizumi, Ueda, Nagano, 386-1192, Japan
TEL +81-268-28-0562 / FAX +81-268-28-0568
http://www.hioki.co.jp / E-mail: os-com@hioki.co.jp

#### **HIOKI USA CORPORATION:**

6 Corporate Drive, Cranbury, NJ 08512 USA TEL +1-609-409-9109 / FAX +1-609-409-9108 http://www.hiokiusa.com / E-mail: hioki@hiokiusa.com

HIOKI (Shanghai) Sales & Trading Co., Ltd. : 1608-1610,Shanghai Times Square Office, 93 Huai Hai Zhong Road Shanghai, P.R.China POSTCODE: 200021 TEL +86-21-63910090/63910092 FAX +86-21-63910360 http://www.hioki.cn / E-mail: info@hioki.com.cn

Beijing Office: TEL +86-10-84418761 / 84418762 Guangzhou Office: TEL +86-20-38392673 / 38392676

HIOKI INDIA PRIVATE LIMITED:

Khandela House, 24 Gulmohar Colony Indore 452 018 (M.P.), India
TEL +91-731-4223901, 4223902 FAX +91-731-4223903

http://www.hioki.in / E-mail: info@hioki.in

HIOKI SINGAPORE PTE. LTD.: 33 Ubi Avenue 3, #03-02 Vertex, Singapore 408868 TEL +65-6634-7677 FAX +65-6634-7477 E-mail: info@hioki.com.sg

DISTRIBUTED BY